

# SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES  
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER

Summary Page

PUBLIC WATER  
SYSTEM NAME: City of Corsicana

PLANT NAME  
OR NUMBER: Navarro Mills

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

PWS ID No.: 1750002  
Report for  
the Month of: October 2011

Operator's Signature: \_\_\_\_\_  
Certificate No. & Grade: WO0004220, A Date: November 3, 2011

## TREATMENT PLANT PERFORMANCE

Total number of turbidity readings:	<u>186</u>	Number of 4-hour periods when plant was off-line:	<u>0</u>
Number of readings above 0.10 NTU:	<u>0</u>	Number of 4-hour periods when plant was on-line but turbidity data was not collected:	<u>0</u>
Number of readings above 0.3 NTU:	<u>0</u>	Number of days when plant was on-line but individual filter turbidity data was not collected:	<u>0</u>
Number of readings above 0.5 NTU:	<u>0</u>	Number of days with readings above 1.0 NTU:	<u>0</u> (2)
Number of readings above 1.0 NTU:	<u>0</u>	Number of days with readings above 5.0 NTU:	<u>0</u> (3)
Maximum allowable turbidity level:	<u>0.3</u>		
Percentage of readings above this limit:	<u>0.0</u> % (1)		

Statistical Summary	Maximum turbidity reading:	<u>0.09</u> NTU	Average turbidity value:	<u>0.06</u> NTU
	Minimum turbidity reading:	<u>0.04</u> NTU	Standard deviation:	<u>0.009</u> NTU
	CFE 95 <sup>th</sup> percentile value:	<u>0.08</u> NTU	IFE 95 <sup>th</sup> percentile:	<u>0.160</u> NTU

Number of days with a low CT for no more than 4.0 consecutive hours:	<u>0</u>	Average log inactivation for Giardia:	<u>NA</u>
Number of days with a low CT for more than 4.0 consecutive hours:	<u>0</u> (4)	Average log inactivation for viruses:	<u>NA</u>
		Number of days when profiling data was not collected:	<u>31</u>
		Number of days when CT data was not collected:	<u>31</u>

Minimum disinfectant residual required leaving the plant: 0.5 mg/L, measured as Total Chlorine

Number of days with a low residual for no more than 4.0 consecutive hours:	<u>0</u>	Number of days when disinfectant residual leaving the plant was not properly monitored:	<u>0</u>
Number of days with a low residual for more than 4.0 consecutive hours:	<u>0</u> (5)		

## DISTRIBUTION SYSTEM

Minimum disinfectant residual required in distribution system: 0.5 mg/L, measured as Total Chlorine

Total number of readings this month:	<u>61</u> (at least 31 required) (8)	Percentage of readings with a low residual this month:	<u>0.0</u> % (6A)
Average disinfectant residual value:	<u>2.51</u>	Percentage of readings with a low residual last month:	<u>0.0</u> % (6B)
Number of readings with a low residual:	<u>0</u>		
Number of readings with no detectable residual:	<u>0</u>		

## ADDITIONAL REPORTS & WORKSHEETS

The Page 1 Addendum (Public Notices) is required because there was at least one treatment technique or monitoring/reporting violation reported.

Additional report(s) for individual filter monitoring required:	<input checked="" type="radio"/> NONE	<input type="radio"/> Filter Profile	<input type="radio"/> Filter Assessment	<input type="radio"/> CPE
Additional report(s) for individual filter monitoring submitted:	<input checked="" type="radio"/> NONE	<input type="radio"/> Filter Profile (9)	<input type="radio"/> Filter Assessment (10)	<input type="radio"/> CPE (11)

No additional IFE Reports are required this month.

**SURFACE WATER MONTHLY OPERATING REPORT**  
TEXAS COMMISSION ON ENVIRONMENTAL QUALITY  
WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-155)  
P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

# SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES  
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)  
*Turbidity Data Page*

PUBLIC WATER SYSTEM NAME: City of Corsicana

PWS ID No.: 1750002

Month: October Year: 2011

PLANT NAME OR NUMBER: Navarro Mills

Connections: 10,854

Population: 23,770

PERFORMANCE DATA																		
Date	Raw Water Pumpage (MGD)	Treated Water Pumpage (MGD)	RAW WATER ANALYSES		SETTLED WATER TURBIDITY (Mandatory Data)						FINISHED WATER QUALITY							
			NTU	Alk.	Basin No.						Turbidity						Lowest Residual	Time†
					1	2	3	4	5	6	NTU1	NTU2	NTU3	NTU4	NTU5	NTU6		
1	5.330	4.710	25	96	0.3	0.4	0.4	0.4	0.4	0.6	0.06	0.07	0.07	0.07	0.07	0.06	2.7	
2	7.660	7.542	32	96	0.3	0.5	0.4	0.5	0.5	0.3	0.06	0.07	0.06	0.05	0.06	0.05	2.6	
3	9.380	7.620	30	95	0.4	0.4	0.5	0.4	0.6	0.4	0.06	0.07	0.06	0.07	0.07	0.06	2.9	
4	9.420	7.865	31	93	0.4	0.6	0.5	0.6	0.5	0.5	0.06	0.07	0.07	0.07	0.07	0.06	2.9	
5	6.500	6.265	32	93	0.4	0.6	0.5	0.4	0.5	0.4	0.06	0.05	0.06	0.06	0.07	0.07	2.9	
6	6.980	5.991	30	91	0.4	0.5	0.4	0.5	0.5	0.5	0.07	0.06	0.06	0.06	0.05	0.06	2.7	
7	8.320	7.068	32	96	0.4	0.4	0.6	0.5	0.4	0.4	0.05	0.06	0.05	0.06	0.06	0.06	2.7	
8	9.460	7.514	35	98	0.4	0.5	0.6	0.5	0.5	0.5	0.06	0.06	0.06	0.07	0.08	0.06	2.9	
9	5.590	5.308	41	100	0.4	0.5	0.5	0.5	0.4	0.5	0.07	0.05	0.06	0.06	0.06	0.06	3.0	
10	7.160	4.556	35	96	x	0.5	0.5	0.5	0.5	0.4	0.06	0.06	0.05	0.05	0.06	0.06	2.9	
11	8.360	5.726	31	92	0.6	x	x	0.7	0.6	0.5	0.07	0.06	0.07	0.05	0.05	0.05	3.3	
12	7.540	5.141	42	96	0.4	0.5	0.6	x	x	0.3	0.05	0.05	0.07	0.07	0.06	0.07	3.1	
13	5.870	4.730	33	97	0.4	0.4	0.6	1.1	1.0	x	0.06	0.06	0.06	0.06	0.06	0.05	2.8	
14	7.730	6.188	39	93	0.5	0.5	0.6	0.6	0.6	0.9	0.05	0.06	0.07	0.07	0.07	0.06	2.0	
15	4.340	3.917	38	97	0.4	0.5	0.7	0.5	0.5	0.5	0.06	0.06	0.05	0.06	0.06	0.06	2.6	
16	4.350	4.106	42	96	0.4	0.5	0.6	0.6	0.5	0.5	0.06	0.05	0.05	0.05	0.05	0.05	2.6	
17	7.490	6.696	39	97	0.5	0.5	0.8	0.6	0.5	0.5	0.05	0.05	0.05	0.05	0.06	0.06	2.8	
18	5.490	4.485	32	95	0.6	0.7	0.8	0.6	0.6	0.6	0.06	0.06	0.07	0.07	0.07	0.06	3.1	
19	6.050	5.073	29	95	0.4	0.6	0.7	0.6	0.5	0.7	0.06	0.05	0.06	0.06	0.07	0.07	2.9	
20	7.220	5.979	33	95	0.5	0.8	0.7	0.8	0.6	0.9	0.06	0.06	0.07	0.07	0.07	0.06	2.7	
21	7.160	6.200	45	97	0.7	0.8	1.0	1.0	0.8	0.9	0.05	0.06	0.06	0.08	0.07	0.07	2.9	
22	7.050	6.012	42	98	0.6	0.6	0.8	0.8	0.9	0.9	0.07	0.06	0.07	0.07	0.08	0.08	2.9	
23	7.040	5.815	36	96	0.6	0.7	0.8	0.8	0.7	1.1	0.08	0.08	0.08	0.08	0.09	0.09	2.9	
24	5.740	4.963	33	95	0.7	0.6	0.8	0.9	0.7	0.8	0.07	0.07	0.06	0.06	0.07	0.06	3.0	
25	4.370	3.886	39	96	0.6	1.0	0.8	0.9	0.7	1.2	0.07	0.07	0.06	0.06	0.07	0.07	3.1	
26	4.320	4.296	35	98	0.5	0.7	0.7	0.7	0.7	0.9	0.09	0.09	0.06	0.07	0.08	0.08	2.9	
27	5.990	4.295	35	96	0.5	0.7	0.6	0.7	0.5	1.2	0.07	0.07	0.06	0.07	0.07	0.07	3.1	
28	7.120	5.706	29	95	0.4	0.6	0.6	0.6	0.5	1.4	0.06	0.07	0.07	0.07	0.07	0.07	3.3	
29	6.630	5.458	32	96	0.4	0.6	0.5	0.6	0.4	0.9	0.07	0.09	0.06	0.06	0.07	0.06	3.2	
30	5.300	4.790	35	98	0.4	0.4	0.5	0.6	0.4	0.6	0.06	0.06	0.04	0.06	0.07	0.08	3.1	
31	5.420	4.568	46	100	0.5	0.6	0.7	0.7	0.6	0.5	0.05	0.06	0.05	0.05	0.06	0.05	2.9	
Total	206.380	172.469																
Avg	6.657	5.564																
Max	9.460	7.865																
Min	4.320	3.886																

NOTE: ONLY use the "Time" column to show the length of time that the disinfectant residual entering the distribution system fell below the acceptable level.

SUBMITTED BY: \_\_\_\_\_ Certificate No. and Grade: WO0004220, A Date: November 3, 2011

# SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES  
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)  
Filter Data Page

PUBLIC WATER  
SYSTEM NAME: City of Corsicana

PLANT NAME  
OR NUMBER: Navarro Mills

PWS ID No.: 1750002

Month: October Year: 2011

PERFORMANCE DATA																				
INDIVIDUAL FILTER TURBIDITY																				
Date	Filter No. 1		Filter No. 2		Filter No. 3		Filter No. 4		Filter No. 5		Filter No. 6		Filter No. 7		Filter No. 8		Filter No. 9		Filter No. 10	
	Max	4 Hrs	Max	4 Hrs																
1	0.08	x	0.07	x	0.07	x	0.08	x	0.18	0.11	0.10	x								
2	0.11	x	0.12	0.08	0.12	x	0.09	x	0.12	x	0.13	x								
3	0.08	x	0.09	x	x	x	0.08	x	0.11	x	0.08	x								
4	0.08	x	0.09	x	0.11	0.07	0.08	x	0.11	x	0.08	x								
5	0.20	x	0.08	x	0.08	x	0.08	x	0.09	x	x	x								
6	0.06	x	0.07	x	0.09	x	0.11	x	0.09	x	0.15	0.08								
7	0.11	0.07	0.06	x	0.08	x	x	x	0.09	x	0.09	x								
8	0.08	x	0.06	x	0.08	x	x	x	0.09	x	0.08	x								
9	0.07	x	0.06	x	0.07	x	0.11	x	0.09	x	0.07	x								
10	0.07	x	0.06	x	0.07	x	0.09	0.07	0.14	0.09	0.07	x								
11	0.08	x	0.12	0.09	0.09	x	0.08	x	0.11	x	0.11	x								
12	0.07	x	0.09	x	x	x	0.08	x	0.11	x	0.13	0.07								
13	x	x	0.07	x	0.10	0.08	0.07	x	0.10	x	0.08	x								
14	x	x	0.07	x	0.09	x	0.07	x	0.11	x	0.08	x								
15	x	x	0.06	x	x	x	0.07	x	0.09	x	0.07	x								
16	x	x	0.06	x	x	x	0.06	x	0.08	x	0.06	x								
17	x	x	0.08	x	0.10	x	0.10	x	0.12	x	0.08	x								
18	x	x	0.08	x	0.10	x	0.09	x	0.11	x	0.08	x								
19	0.24	0.10	0.11	x	0.12	x	0.26	x	0.17	0.12	0.11	x								
20	0.09	x	0.06	x	0.08	x	0.11	x	0.12	x	0.17	x								
21	0.09	x	0.06	x	0.08	x	x	x	0.11	x	0.16	0.15								
22	0.09	x	0.06	x	0.08	x	0.14	0.13	0.11	x	0.10	x								
23	0.11	x	x	x	0.11	x	0.14	x	0.13	x	0.08	x								
24	0.08	x	x	x	0.07	x	0.09	x	0.10	x	0.36	x								
25	0.08	x	x	x	x	x	0.10	x	0.12	x	0.11	x								
26	0.08	x	x	x	x	x	0.10	x	0.10	x	0.09	x								
27	0.13	x	x	x	x	x	0.11	x	0.14	x	0.13	x								
28	0.07	x	x	x	x	x	0.09	x	0.10	x	0.08	x								
29	0.06	x	x	x	x	x	0.07	x	0.09	x	0.07	x								
30	0.06	x	0.16	0.06	0.15	0.07	0.05	x	0.07	x	0.06	x								
31	x	x	0.08	x	0.08	x	0.07	x	x	x	0.07	x								

SUMMARY & COMPLIANCE ACTIONS	Criteria	Filter No.										Plant
		1	2	3	4	5	6	7	8	9	10	
Number of days with event(s) above 0.5 NTU at 4.0 hrs this month	0	0	0	0	0	0	0					
Number of days with event(s) above 1.0 NTU this month	0	0	0	0	0	0	0					
Number of days with event(s) above 1.0 NTU last month	0	0	0	0	0	0	0					
Number of days with event(s) above 1.0 NTU two months ago	0	0	0	0	0	0	0					
Total number of days with event(s) above 1.0 NTU in three months	0	0	0	0	0	0	0					
Number of days with event(s) above 2.0 NTU this month												0
Number of days with event(s) above 2.0 NTU last month												0
Does the filter/plant have an approved Corrective Action Plan?	N	N	N	N	N	N	N					N
Is the plant required to submit a Filter Profile Report?	N	N	N	N	N	N	N					
Is the plant required to submit a Filter Assessment Report?	N	N	N	N	N	N	N					
Is the plant required to submit a Request for Compliance CPE?												N

SUBMITTED BY: \_\_\_\_\_ Certificate No. \_\_\_\_\_ and Grade: WO0004220, A Date: November 3, 2011

# SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES  
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)

## Disinfection Data Page

PUBLIC WATER SYSTEM NAME: City of Corsicana  
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills  
Month: October Year: 2011

DISINFECTION PROCESS PARAMETERS							
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS		
Parameters	Disinfection Zones					Log Inactivations	
	D1	D2	D3	D4	D5	Giardia lamblia Cysts	Viruses
Flow Rate (MGD)	20.250	20.250	20.250			0.5	2.0
T <sub>10</sub> (minutes)	109.1	13.0	100.0				

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Timet
1	NA D1								
	FCL D2	0.3	9.300	24.0	7.0				
	CLA D3	3.1	9.300	25.0	7.9				
	D4								
	D5								
2	NA D1								
	FCL D2	0.2	9.400	24.0	7.0				
	CLA D3	3.4	9.400	24.0	7.9				
	D4								
	D5								
3	NA D1								
	FCL D2	0.3	9.400	23.0	6.9				
	CLA D3	3.2	9.400	23.0	7.8				
	D4								
	D5								
4	NA D1								
	FCL D2	0.3	9.500	23.0	7.0				
	CLA D3	3.4	9.500	23.0	7.7				
	D4								
	D5								
5	NA D1								
	FCL D2	0.6	9.500	23.0	7.0				
	CLA D3	3.1	9.500	23.0	7.8				
	D4								
	D5								
6	NA D1								
	FCL D2	0.3	7.100	22.0	7.1				
	CLA D3	2.9	7.100	23.0	7.8				
	D4								
	D5								
7	NA D1								
	FCL D2	0.4	9.500	24.0	7.0				
	CLA D3	2.8	9.500	24.0	8.0				
	D4								
	D5								
8	NA D1								
	FCL D2	0.5	9.500	23.0	7.1				
	CLA D3	2.9	9.500	23.0	8.1				
	D4								
	D5								

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Timet
9	NA D1								
	FCL D2	0.6	9.500	23.0	7.1				
	CLA D3	3.0	9.500	23.0	7.7				
	D4								
	D5								
10	NA D1								
	FCL D2	0.4	9.600	22.0	7.0				
	CLA D3	2.9	9.600	23.0	8.1				
	D4								
	D5								
11	NA D1								
	FCL D2	0.6	12.600	22.0	7.0				
	CLA D3	3.3	12.600	23.0	7.8				
	D4								
	D5								
12	NA D1								
	FCL D2	0.7	12.800	22.0	7.0				
	CLA D3	3.2	12.800	23.0	7.8				
	D4								
	D5								
13	NA D1								
	FCL D2	0.8	9.600	22.0	7.2				
	CLA D3	3.1	9.600	23.0	8.2				
	D4								
	D5								
14	NA D1								
	FCL D2	0.3	8.000	23.0	7.1				
	CLA D3	2.8	8.000	23.0	7.2				
	D4								
	D5								
15	NA D1								
	FCL D2	0.2	4.400	23.0	7.1				
	CLA D3	2.7	4.400	23.0	7.6				
	D4								
	D5								
16	NA D1								
	FCL D2	0.1	4.400	23.0	7.1				
	CLA D3	2.6	4.400	23.0	7.8				
	D4								
	D5								

NOTE: \* ONLY use the "Timet" column to show the length of time that the total inactivation ratio was less than 1.00.

SUBMITTED BY: \_\_\_\_\_ Certificate No. and Grade: WO0004220, A Date: November 3, 2011

# SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES  
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)  
*Disinfection Data Page (cont.)*

PUBLIC WATER SYSTEM NAME: City of Corsicana  
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills  
Month: October Year: 2011

DISINFECTION PROCESS PARAMETERS							
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS		
Parameters	Disinfection Zones					Log Inactivations	
	D1	D2	D3	D4	D5	Giardia lamblia Cysts	Virus
Flow Rate (MGD)	20.250	20.250	20.250			0.5	2.0
T <sub>10</sub> (minutes)	109.1	13.0	100.0				

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Timet
17	NA D1								
	FCL D2	0.4	9.500	23.0	7.0				
	CLA D3	3.1	9.500	23.0	7.7				
	D4								
	D5								
18	NA D1								
	FCL D2	0.6	9.500	23.0	7.0				
	CLA D3	3.1	9.500	24.0	7.7				
	D4								
	D5								
19	NA D1								
	FCL D2	0.3	7.200	21.0	7.2				
	CLA D3	3.3	7.200	22.0	8.0				
	D4								
	D5								
20	NA D1								
	FCL D2	0.4	7.300	20.0	7.1				
	CLA D3	3.1	7.300	21.0	7.7				
	D4								
	D5								
21	NA D1								
	FCL D2	0.5	7.300	20.0	7.1				
	CLA D3	2.9	7.300	22.0	7.5				
	D4								
	D5								
22	NA D1								
	FCL D2	0.3	7.100	20.0	7.2				
	CLA D3	3.0	7.100	20.0	7.8				
	D4								
	D5								
23	NA D1								
	FCL D2	0.3	7.100	19.0	7.1				
	CLA D3	3.1	7.100	20.0	7.7				
	D4								
	D5								
24	NA D1								
	FCL D2	0.3	7.100	19.0	7.0				
	CLA D3	3.3	7.100	20.0	7.7				
	D4								
	D5								

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Timet
25	NA D1								
	FCL D2	0.4	4.400	21.0	7.0				
	CLA D3	3.1	4.400	21.0	7.6				
	D4								
	D5								
26	NA D1								
	FCL D2	0.4	4.400	20.0	7.0				
	CLA D3	3.1	4.400	21.0	7.8				
	D4								
	D5								
27	NA D1								
	FCL D2	0.7	7.200	20.0	7.2				
	CLA D3	3.2	7.200	21.0	7.7				
	D4								
	D5								
28	NA D1								
	FCL D2	0.3	7.200	19.0	7.0				
	CLA D3	3.4	7.200	20.0	7.8				
	D4								
	D5								
29	NA D1								
	FCL D2	0.4	7.100	19.0	7.0				
	CLA D3	3.2	7.100	20.0	8.0				
	D4								
	D5								
30	NA D1								
	FCL D2	0.2	5.300	19.0	7.1				
	CLA D3	3.1	5.300	19.0	7.7				
	D4								
	D5								
31	NA D1								
	FCL D2	0.1	5.600	19.0	7.0				
	CLA D3	3.1	5.600	19.0	7.8				
	D4								
	D5								

Max	NA	NA
Min	NA	NA
Avg	NA	NA
SD	NA	NA

NOTE: ONLY use the "Timet" column to show the length of time that the total inactivation ratio was less than 1.00.

SUBMITTED BY: \_\_\_\_\_ Certificate No. and Grade: WO0004220, A Date: November 3, 2011

# MONTHLY TOTAL ORGANIC CARBON REMOVAL REPORT (TOCMOR)

## FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana  
 PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills  
 Month: October Year: 2011

Type of treatment:  Conventional  Unconventional explain: \_\_\_\_\_

Note: Systems are required to run one TOC Sample Set every month. Additional space is provided for those systems that do additional sampling

Test No.	Test Date	Monthly TOC Sample Set			Actual % TOC Removed	Step 1 Required % Removal	Step 1 Removal Ratio	Optional data		COMPLIANCE REMOVAL RATIO
		Raw Alkalinity	Raw TOC	Treated TOC				Step 2 Required % Removal	Step 2 Removal Ratio	
		Enter the Sample Set results						calculated	calculated from matrix	
1	10/4	101	4.71	3.76	20.2	35	0.58			0.58
2										
3										
4										
5										
6										
7										
8										
9										
10										
11										
12										
13										
14										
15										
16										
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
31										
Avg		101.00	4.71	3.76	20.17		0.58			0.58
Max		101.00	4.71	3.76	20.17		0.58			0.58
Min		101.00	4.71	3.76	20.17		0.58			0.58

### TOTAL ORGANIC CARBON (TOC) REMOVAL SUMMARY

TOC Summary: Don't forget to include a copy of your P.7-TOC ACC worksheet with your report.					Monthly Compliance Ratio
Raw Water Alkalinity	Raw Water TOC	Treated Water TOC	TOC % Removal	ACC # used	
101	4.71	3.76	20.2	5 Mo. Avg	1.00

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: \_\_\_\_\_ Certificate No. and Grade: WO0004220, A

Date: November 3, 2011

**Submit the report by the 10th of the month following the reporting period to:**  
 TEXAS COMMISSION ON ENVIRONMENTAL QUALITY  
 WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-165)  
 P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

**TOC ALTERNATIVE COMPLIANCE CRITERIA REPORT**  
FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana  
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills  
Month: October Year: 2011

This Alternative Compliance Criteria (ACC) Report is being submitted to request the following ACC: (check one)  
(Before you can begin entering data, you must put an "X" in the box that shows the number of the Alternative Compliance Criteria you are applying for.)

#1  #2  #3  #4  #5  #6  #7  #8

ACC #1

ACC #2

ACC #3

ACC #4

ACC #5 Source water SUVA less than or equal to 2.0 L/mg-m?  
(either based on most recent month's data OR calculated quarterly as a running annual average)  
(Source water SUVA is the dissolved organic carbon concentration divided by the ultraviolet light absorption at 254 nanometers in the source water before any treatment of any kind. Measure monthly.)

Current Month SUVA	
1.66	

ACC #6

ACC #7

ACC #8

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: \_\_\_\_\_ Certificate No. and Grade: WO0004220\_A Date: November 3, 2011

# STEP 2 JAR TEST REPORT

FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana  
 PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills  
 DATE OF JAR TEST: \_\_\_\_\_

PLANT CONDITIONS								
RAW WATER SOURCE(s)	COAGULANT		COAGULANT AID		FLOC AID		pH ADJUSTMENT	
	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)


STEP 2 JAR TEST PARAMETERS									
COAGULANT		BASE		JAR SIZE	JAR TEST CONDITIONS				
Type	Stock Solution Concentration (g/L)	Type	Stock Solution Concentration (g/L)	Volume (liters)	Rapid Mix		Flocculation		Settling
					Speed (rpm)	Duration (minutes)	Speed (rpm)	Duration (minutes)	Duration (minutes)

JAR TEST RESULTS									
Jar No.	COAGULANT		BASE		Alkalinity (mg/L as CaCO <sub>3</sub> )	pH	TOC (mg/L)	Incremental TOC Removal (mg/L TOC removed per 10 mg/L of alum)	Cumulative TOC Removal (%)
	Dose (Alum eq.) (mg/L)	Volume (mL)	Dose (mg/L)	Volume (mL)					
RAW	0								
1									
2									
3									
4									
5									
6									
7									
8									
9									
10									
11									
12									

Target pH (based on raw water alkalinity)

Has the TCEQ approved this source as "Not Amenable" to Treatment even though Target pH was not reached?  
 If "yes", provide the date of the TCEQ letter or e-mail.

TOC, % Removal at Apparent PODR:

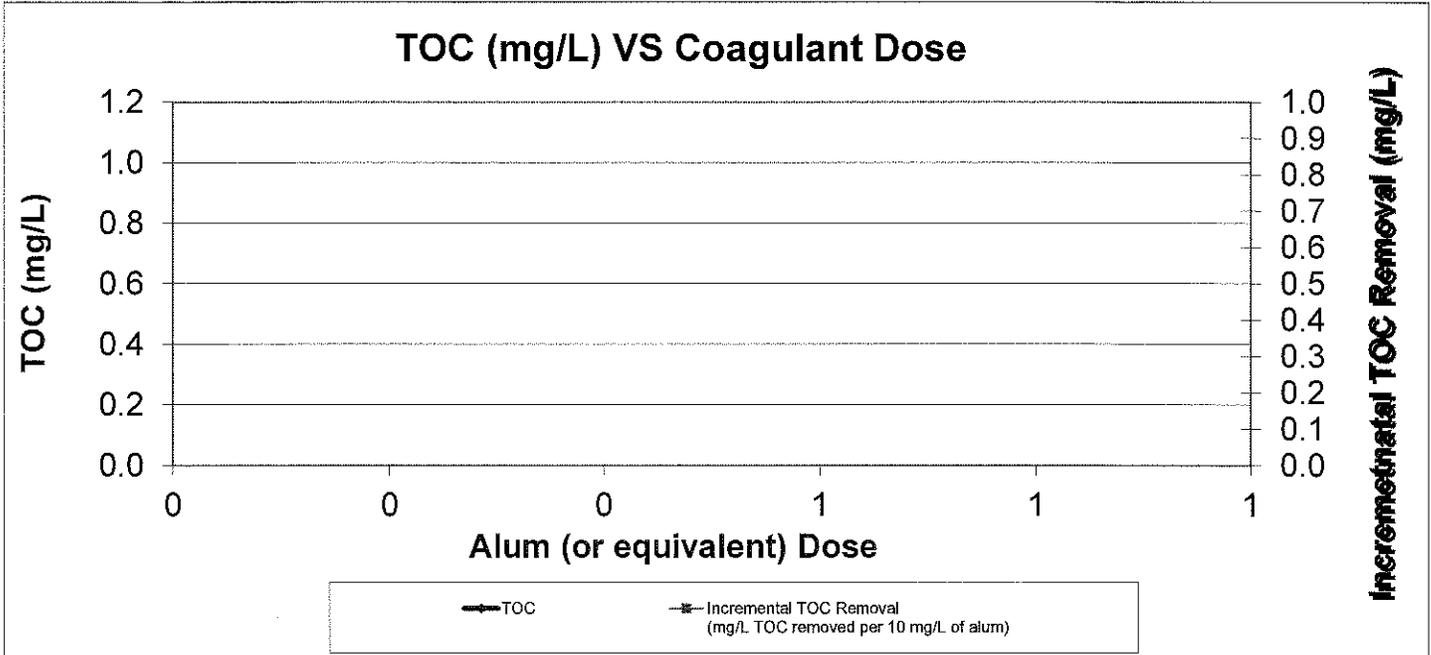

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: \_\_\_\_\_

Certificate No. and Grade: WO0004220, A