

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER

Summary Page

PUBLIC WATER

SYSTEM NAME: City Of Corsicana

PLANT NAME

OR NUMBER: Lake Halbert WTP

I certify that I am familiar with the information contained in this report and that,
to the best of my knowledge, the information is true, complete, and accurate.

PWS ID No.: 1750002

Operator's Signature: _____

Report for

the Month of: March 2010

Certificate No. & Grade: WO0012234, A

Date: April 1, 2010

TREATMENT PLANT PERFORMANCE

Total number of turbidity readings: <u>95</u>	Number of 4-hour periods when plant was off-line: <u>91</u>
Number of readings above 0.10 NTU: <u>44</u>	Number of 4-hour periods when plant was on-line but turbidity data was not collected: <u>0</u>
Number of readings above 0.3 NTU: <u>0</u>	Number of days when plant was on-line but individual filter turbidity data was not collected: <u>0</u>
Number of readings above 0.5 NTU: <u>0</u>	Number of days with readings above 1.0 NTU: <u>0</u> (2)
Number of readings above 1.0 NTU: <u>0</u>	Number of days with readings above 5.0 NTU: <u>0</u> (3)
Maximum allowable turbidity level: <u>0.3</u>	
Percentage of readings above this limit: <u>0.0</u> % (1)	

Statistical Summary

Maximum turbidity reading: <u>0.22</u> NTU	Average turbidity value: <u>0.11</u> NTU
Minimum turbidity reading: <u>0.06</u> NTU	Standard deviation: <u>0.028</u> NTU
CFE 95 th percentile value: <u>0.16</u> NTU	IFE 95 th percentile: <u>0.165</u> NTU

Number of days with a low CT for no more than 4.0 consecutive hours: <u>0</u>	Average log inactivation for Giardia: <u>NA</u>
Number of days with a low CT for more than 4.0 consecutive hours: <u>0</u> (4)	Average log inactivation for viruses: <u>NA</u>
	Number of days when profiling data was not collected: <u>23</u>
	Number of days when CT data was not collected: <u>23</u>

Minimum disinfectant residual required leaving the plant: 0.5 mg/L, measured as Total Chlorine

Number of days with a low residual for no more than 4.0 consecutive hours: <u>0</u>	Number of days when disinfectant residual leaving the plant was not properly monitored: <u>0</u>
Number of days with a low residual for more than 4.0 consecutive hours: <u>0</u> (5)	

DISTRIBUTION SYSTEM

Minimum disinfectant residual required in distribution system: <u>0.5</u> mg/L, measured as Total Chlorine	
Total number of readings this month: <u>61</u> (at least 31 required) (8)	Percentage of readings with a low residual this month: <u>0.0</u> % (6A)
Average disinfectant residual value: <u>2.40</u>	Percentage of readings with a low residual last month: <u>0.0</u> % (6B)
Number of readings with a low residual: <u>0</u>	
Number of readings with no detectable residual: <u>0</u>	

ADDITIONAL REPORTS & WORKSHEETS

The Page 1 Addendum (Public Notices) is required because there was at least one treatment technique or monitoring/reporting violation reported.

Additional report(s) for individual filter monitoring required:	<input checked="" type="radio"/> NONE	<input type="radio"/> Filter Profile	<input type="radio"/> Filter Assessment	<input type="radio"/> CPE
Additional report(s) for individual filter monitoring submitted:	<input checked="" type="radio"/> NONE	<input type="radio"/> Filter Profile (9)	<input type="radio"/> Filter Assessment (10)	<input type="radio"/> CPE (11)
No additional IFE Reports are required this month.				

SURFACE WATER MONTHLY OPERATING REPORT
TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-155)
P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Summary Page Addendum (Violations and Public Notices)

PUBLIC WATER SYSTEM NAME: City Of Corsicana

PLANT NAME OR NUMBER: Lake Halbert WTP

PWS ID No.: 1750002

Month: March

Year: 2010

PUBLIC NOTICES						
VIOLATION TYPE	DESCRIPTION OF VIOLATION	VIOLATION OCCURRED?	NOTICE TO TCEQ <input checked="" type="checkbox"/>	NOTICE TO CUSTOMER *		VIOLATION DATES
			DATE OF NOTICE	DATE OF NOTICE	PENDING	
TREATMENT TECHNIQUE	Were more than 5.0% of the turbidity readings above the acceptable level? - see (1) on the <i>Summary Page</i>	No				
	Were there any days with turbidity readings above 1.0 NTU? - see (2) on the <i>Summary Page</i>	No				
	Were there any days with turbidity readings above 5.0 NTU? - see (3) on the <i>Summary Page</i>	No				
	Were there any periods when the plant failed to meet the CT requirements for more than 4.0 consecutive hours? - see (4) on the <i>Summary Page</i>	No				
	Were there any periods when the residuals leaving the plant fell below the acceptable level for more than 4.0 consecutive hours? - see (5) on the <i>Summary Page</i>	No				
	Were more than 5.0% of the residuals in the distribution system below the acceptable level for two months in a row? - see (6A) and (6B) on the <i>Summary Page</i>	No				
MONITORING & REPORTING	Were there any days when the plant failed to report all of the required Combined Filter Effluent (CFE) turbidity readings? - see the <i>Turbidity Data Page</i>	No				
	Were there any days when the plant failed to report all the CT data needed to evaluate the level of microbial inactivation achieved? - see the <i>Disinfection Data Page</i>	Yes				1, 2, 3, 4, 6, 8, 9, 11, 12, 13, 15, 16, 19, 20, 22, 23, 24, 25, 26, 27, 29, 30, 31,
	Were there any days when the plant failed to report the minimum disinfectant residual entering the distribution system? - see the <i>Turbidity Data Page</i>	No				
	Did the system fail to collect enough samples in the distribution system to meet the minimum disinfectant monitoring requirements? - see (8) on the <i>Summary Page</i>	No				
	Were there any days when the plant failed to report the maximum individual filter effluent (IFE) turbidity level produced by each filter? - see the <i>Filter Data Page</i>	No				
	Were there any days when the plant failed to report the IFE turbidity level 4-hours after beginning a filter run? - see the <i>Filter Data Page</i>	No				
	Did the plant fail to submit a Filter Profile Report if one was required? - see (9) on the <i>Summary page</i>	No				
	Did the plant fail to submit a Filter Assessment Report if one was required? - see (10) on the <i>Summary Page</i>	No				
	Did the plant fail to submit a Comprehensive Performance Evaluation Request if one was required? - see (11) on the <i>Summary Page</i>	No				
Did the plant fail to collect at least one Total Organic Carbon sample set? - see <i>TOCMOR Page</i>	No					

Treatment technique violation notices are due no later than the end of the next business day. Please include a copy if possible.
* Copies of each Public Notice must accompany this report if they have already been issued.

SUMMITTED BY: _____

Certificate No. and Grade: WO0012234, A

Date: April 1, 2010

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)

Turbidity Data Page

PUBLIC WATER SYSTEM NAME: City Of Corsicana

PLANT NAME OR NUMBER: Lake Halbert WTP

PWS ID No.: 1750002

Connections: 10,732

Month: March Year: 2010

Population: 28,500

PERFORMANCE DATA																			
Date	Raw Water Pumpage (MGD)	Treated Water Pumpage (MGD)	RAW WATER ANALYSES		SETTLED WATER TURBIDITY (Optional Data)						FINISHED WATER QUALITY								
			NTU	Alk.	Basin No.						Turbidity						Lowest Residual	Time	
					1	2	3	4	5	6	NTU1	NTU2	NTU3	NTU4	NTU5	NTU6			
1	2.819	2.689	41	84								X	0.10	0.15	0.10	0.09	0.12	3.0	
2	2.627	2.238	41	85								0.12	0.14	0.22	0.18	0.12	0.10	3.6	
3	1.993	1.700	40	72								X	X	0.13	0.09	0.09	X	3.4	
4	2.585	2.474	37	75								X	X	0.09	0.08	0.10	0.11	2.9	
5	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
6	2.811	2.600	38	77								X	X	0.08	0.08	0.08	0.09	2.6	
7	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
8	3.148	2.416	36	80								X	X	0.14	0.09	0.10	0.12	2.8	
9	1.623	1.369	45	90								0.10	0.09	X	X	X	0.09	2.9	
10	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
11	2.000	1.975	38	68								X	X	0.12	0.10	0.09	0.08	2.5	
12	1.801	1.508	36	81								0.08	0.10	0.08	0.08	X	X	2.7	
13	2.173	1.913	39	85								X	X	X	0.13	0.11	0.12	2.6	
14	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
15	2.563	2.466	36	86								X	X	0.13	0.12	0.10	0.09	2.4	
16	3.240	3.029	34	91								0.10	0.09	0.09	0.09	0.06	0.06	2.8	
17	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
18	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
19	4.022	3.746	37	84								X	0.16	0.16	0.12	0.12	0.13	2.7	
20	1.461	1.217	35	84								0.12	0.13	0.12	X	X	X	3.4	
21	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
22	1.069	0.649	39	42								X	X	0.22	0.17	X	X	2.5	
23	2.200	2.145	36	65								X	X	0.13	0.12	0.10	0.11	3.0	
24	2.436	2.325	35	69								0.11	0.11	0.10	0.09	0.08	0.08	3.4	
25	2.125	2.124	36	95								X	X	0.16	0.13	0.13	0.13	3.2	
26	1.230	1.020	36	88								0.13	0.12	0.11	0.09	X	X	2.7	
27	2.093	1.910	31	85								X	X	X	0.09	0.11	0.08	3.0	
28	0.000	0.000	X	X	X	X						X	X	X	X	X	X	X	
29	1.687	1.471	32	67								X	X	0.12	0.11	0.08	0.08	2.9	
30	2.550	2.539	37	83								0.11	0.11	0.09	0.09	0.09	0.08	3.0	
31	1.910	1.810	30	86								X	X	0.08	0.10	0.09	0.09	3.4	
Total	52.166	47.333																	
Avg	1.683	1.527																	
Max	4.022	3.746																	
Min	0.000	0.000																	

NOTE: ONLY use the "Time*" column to show the length of time that the disinfectant residual entering the distribution system fell below the acceptable level.

SUBMITTED BY: _____ Certificate No. and Grade: WO0012234, A Date: April 1, 2010

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Filter Data Page

PUBLIC WATER
SYSTEM NAME: City Of Corsicana
PWS ID No.: 1750002

PLANT NAME
OR NUMBER: Lake Halbert WTP
Month: March Year: 2010

PERFORMANCE DATA																				
Date	INDIVIDUAL FILTER TURBIDITY																			
	Filter No. 1		Filter No. 2		Filter No. 3		Filter No. 4		Filter No. 5		Filter No. 6		Filter No. 7		Filter No. 8		Filter No. 9		Filter No. 10	
	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs	Max	4 Hrs
1	0.10	0.10	0.06	0.05	0.06	0.06	0.07	0.07												
2	0.11	0.11	0.12	0.07	0.10	0.10	0.21	0.21												
3	0.07	0.07	0.07	0.07	0.07	0.07	0.09	0.07												
4	0.10	0.10	0.06	0.06	0.07	0.07	0.12	0.11												
5	X	X	X	X	X	X	X	X												
6	0.09	0.09	0.08	0.08	0.06	0.06	0.11	0.11												
7	X	X	X	X	X	X	X	X												
8	0.11	0.11	0.10	0.09	0.14	0.10	0.09	0.09												
9	0.06	0.05	0.06	0.06	0.08	0.07	0.08	0.06												
10	X	X	X	X	X	X	X	X												
11	0.10	0.10	0.10	0.07	0.07	0.07	0.05	0.05												
12	0.07	X	0.06	X	0.06	X	0.09	X												
13	0.11	0.11	0.13	0.06	0.07	0.05	0.15	0.15												
14	X	X	X	X	X	X	X	X												
15	0.09	0.09	0.10	0.10	0.12	0.11	0.12	0.12												
16	0.07	X	0.08	X	0.09	X	0.11	X												
17	X	X	X	X	X	X	X	X												
18	X	X	X	X	X	X	X	X												
19	0.13	0.13	0.16	0.16	0.13	0.06	0.15	0.15												
20	0.07	X	0.11	X	0.05	X	0.10	X												
21	X	X	X	X	X	X	X	X												
22	0.16	0.16	0.08	0.08	0.19	0.19	0.18	0.18												
23	0.12	0.12	0.07	0.07	X	X	0.17	0.17												
24	0.08	X	0.07	X	0.11	X	0.17	X												
25	0.11	0.11	0.14	0.14	0.08	0.08	0.13	0.11												
26	0.08	X	0.11	X	0.07	X	0.11	X												
27	0.06	0.06	0.08	0.08	0.06	0.06	0.07	0.07												
28	X	X	X	X	X	X	X	X												
29	0.12	0.12	0.06	0.06	0.05	0.05	0.07	0.07												
30	0.08	0.08	0.06	0.06	0.11	0.11	0.07	X												
31	0.06	0.06	0.10	0.09	0.07	0.07	0.06	0.06												

SUMMARY & COMPLIANCE ACTIONS	Criteria	Filter No.										Plant								
		1	2	3	4	5	6	7	8	9	10									
	Number of days with event(s) above 0.5 NTU at 4.0 hrs this month	0	0	0	0															
	Number of days with event(s) above 1.0 NTU this month	0	0	0	0															
	Number of days with event(s) above 1.0 NTU last month	0	0	0	0															
	Number of days with event(s) above 1.0 NTU two months ago	0	0	0	0															
	Total number of days with event(s) above 1.0 NTU in three months	0	0	0	0															
	Number of days with event(s) above 2.0 NTU this month											0								
	Number of days with event(s) above 2.0 NTU last month											0								
	Does the filter/plant have an approved Corrective Action Plan?	N	N	N	N															N
	Is the plant required to submit a Filter Profile Report?	N	N	N	N															
	Is the plant required to submit a Filter Assessment Report?	N	N	N	N															
	Is the plant required to submit a Request for Compliance CPE?											N								

SUBMITTED BY: _____ Certificate No. _____ and Grade: WO0012234, A Date: April 1, 2010

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Disinfection Data Page

PUBLIC WATER SYSTEM NAME: City Of Corsicana
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Lake Halbert WTP
Month: March Year: 2010
PUBLIC SYSTEM PWS ID

DISINFECTION PROCESS PARAMETERS										
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS					
Parameters	Disinfection Zones					Log Inactivations				Paran
	D1	D2	D3	D4	D5	Giardia lamblia Cysts		Viruses		
Flow Rate (MGD)	4.000	4.000	4.000			0.5		2.0		Flow
T ₁₀ (minutes)	78.3	15.1	9.0							T ₁₀ (m

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time
1	NA D1								
	FCL D2	3.2	2.500	8.0	7.2				
	CLA D3	3.0	2.500	9.0	7.3				
	D4								
	D5								
2	NA D1								
	FCL D2	4.0	3.800	11.0	7.4				
	CLA D3	3.8	3.800	10.0	7.3				
	D4								
	D5								
3	NA D1								
	FCL D2	3.8	3.800	13.0	7.4				
	CLA D3	3.7	3.800	10.0	7.3				
	D4								
	D5								
4	NA D1								
	FCL D2	4.0	4.000	10.0	7.3				
	CLA D3	3.7	4.000	10.0	7.3				
	D4								
	D5								
5	NA D1								
	NA D2								
	NA D3					NA	NA	NA	
	D4								
	D5								
6	NA D1								
	FCL D2	3.9	4.000	12.0	7.5				
	CLA D3	2.6	4.000	11.0	7.6				
	D4								
	D5								
7	NA D1								
	NA D2								
	NA D3					NA	NA	NA	
	D4								
	D5								
8	NA D1								
	FCL D2	3.0	4.000	14.0	7.5				
	CLA D3	2.8	4.000	13.0	7.6				
	D4								
	D5								

PERFORMANCE DATA										
DISINFECTION PROCESS DATA										
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time	Date
9	NA D1									17
	FCL D2	3.4	3.800	12.0	7.3					
	CLA D3	3.4	3.800	13.0	7.3					
	D4									
	D5									
10	NA D1									18
	NA D2									
	NA D3					NA	NA	NA		
	D4									
	D5									
11	NA D1									19
	FCL D2	3.8	3.500	15.0	7.7					
	CLA D3	3.5	3.500	14.0	7.4					
	D4									
	D5									
12	NA D1									20
	FCL D2	3.0	3.500	13.0	7.5					
	CLA D3	3.3	3.500	13.0	7.3					
	D4									
	D5									
13	NA D1									21
	FCL D2	2.5	3.800	15.0	7.9					
	CLA D3	2.6	3.800	13.0	8.1					
	D4									
	D5									
14	NA D1									22
	NA D2									
	NA D3					NA	NA	NA		
	D4									
	D5									
15	NA D1									23
	FCL D2	2.0	4.000	15.0	7.7					
	CLA D3	2.4	4.000	14.0	7.7					
	D4									
	D5									
16	NA D1									24
	FCL D2	3.6	4.000	19.0	7.5					
	CLA D3	3.7	4.000	15.0	7.4					
	D4									
	D5									

NOTE: = ONLY use the "Time=" column to show the length of time that the total inactivation ratio was less than 1.00.

NOTE:

SUBMITTED BY: _____ Certificate No. and Grade: WO0012234, A Date: April 1, 2010 SUBMIT

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Disinfection Data Page (cont.)

WATER
PLANT NAME: City Of Corsicana
ID No.: 1750002

PLANT NAME
OR NUMBER: Lake Halbert WTP
Month: March Year: 2010

DISINFECTION PROCESS PARAMETERS							
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS		
Parameters	Disinfection Zones					Log Inactivations	
	D1	D2	D3	D4	D5	Giardia lamblia Cysts	Virus
Rate (MGD)	4.000	4.000	4.000			0.5	2.0
Time (minutes)	78.3	15.1	9.0				

PERFORMANCE DATA								
DISINFECTION PROCESS DATA								
Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time (min)
NA D1								
NA D2								
NA D3					NA	NA	NA	
D4								
D5								
NA D1								
NA D2								
NA D3					NA	NA	NA	
D4								
D5								
NA D1								
FCL D2	2.2	4.000	14.0	7.1				
CLA D3	2.7	4.000	14.0	7.5				
D4								
D5								
NA D1								
FCL D2	3.7	4.000	15.0	7.5				
CLA D3	3.6	4.000	15.0	7.4				
D4								
D5								
NA D1								
NA D2								
NA D3					NA	NA	NA	
D4								
D5								
NA D1								
FCL D2	2.4	2.500	15.0	7.7				
CLA D3	2.5	2.500	14.0	8.0				
D4								
D5								
NA D1								
FCL D2	1.6	2.400	16.0	7.6				
CLA D3	3.0	2.400	13.0	7.8				
D4								
D5								
NA D1								
FCL D2	3.7	2.600	13.0	7.6				
CLA D3	3.9	2.600	14.0	7.6				
D4								
D5								

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time (min)
25	NA D1								
	FCL D2	2.7	2.600	15.0	7.5				
	CLA D3	3.5	2.600	14.0	7.6				
	D4								
	D5								
26	NA D1								
	FCL D2	3.4	3.300	13.0	7.5				
	CLA D3	3.3	3.300	13.0	7.4				
	D4								
	D5								
27	NA D1								
	FCL D2	3.1	3.500	16.0	7.6				
	CLA D3	3.0	3.500	14.0	7.8				
	D4								
	D5								
28	NA D1								
	NA D2								
	NA D3					NA	NA	NA	
	D4								
	D5								
29	NA D1								
	FCL D2	1.8	2.600	16.0	7.7				
	CLA D3	2.9	2.600	15.0	7.6				
	D4								
	D5								
30	NA D1								
	FCL D2	3.6	3.800	16.0	7.1				
	CLA D3	3.5	3.800	15.0	7.4				
	D4								
	D5								
31	NA D1								
	FCL D2	3.6	3.800	16.0	7.2				
	CLA D3	3.4	3.800	15.0	7.6				
	D4								
	D5								
						Max	NA	NA	
						Min	NA	NA	
						Avg	NA	NA	
						SD	NA	NA	

= ONLY use the "Time=" column to show the length of time that the total inactivation ratio was less than 1.00.

ISSUED BY: _____ Certificate No. _____ and Grade: WO0012234, A Date: April 1, 2010

MONTHLY TOTAL ORGANIC CARBON REMOVAL REPORT (TOCMOR)

FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City Of Corsicana
 PWS ID No.: 1750002
 Type of treatment: Conventional Unconventional explain: _____

PLANT NAME OR NUMBER: Lake Halbert WTP
 Month: March Year: 2010

Note: Systems are required to run one TOC Sample Set every month. Additional space is provided for those systems that do additional sampling

Test No.	Test Date	Monthly TOC Sample Set			Actual % TOC Removed	Step 1 Required Removal %	Step 1 Removal Ratio	Optional data		COMPLIANCE REMOVAL RATIO
		Raw Alkalinity	Raw TOC	Treated TOC				Step 2 Required % Removal	Step 2 Removal Ratio	
		Enter the Sample Set results						calculated	calculated from matrix	
1	3/2	86	6.30	4.43	29.7	35	0.85	26.7	1.1	1.11
2										
3										
4										
5										
6										
7										
8										
9										
10										
11										
12										
13										
14										
15										
16										
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
31										
Avg		86.00	6.30	4.43	29.68		0.85		1.1	1.11
Max		86.00	6.30	4.43	29.68		0.85		1.1	1.11
Min		86.00	6.30	4.43	29.68		0.85		1.1	1.11

TOTAL ORGANIC CARBON (TOC) REMOVAL SUMMARY

TOC Summary: Don't forget to include a copy of your P.8-TOC Step 2 worksheet with your report.					Monthly Compliance Ratio
Raw Water Alkalinity	Raw Water TOC	Treated Water TOC	TOC % Removal	ACC # used	
86	6.30	4.43	29.7	NA	1.11

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____ Certificate No. and Grade: WO0012234, A

Date: April 1, 2010

Submit the report by the 10th of the month following the reporting period to:
 TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
 WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-155)
 P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

TOC ALTERNATIVE COMPLIANCE CRITERIA REPORT
FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City Of Corsicana
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Lake Halbert WTP
Month: March Year: 2010

This Alternative Compliance Criteria (ACC) Report is being submitted to request the following ACC: **(check one)**
(Before you can begin entering data, you must put an "X" in the box that shows the number of the Alternative Compliance Criteria you are applying for.)

#1 #2 #3 #4 #5 #6 #7 #8

ACC #1	
--------	--

ACC #2	
--------	--

ACC #3	
--------	--

ACC #4	
--------	--

ACC #5	Source water SUVA less than or equal to 2.0 L/mg-m?													
	<small>(either based on most recent month's data OR calculated quarterly as a running annual average)</small>													
	<small>(Source water SUVA is the dissolved organic carbon concentration divided by the ultraviolet light absorption at 254 nanometers in the source water before any treatment of any kind. Measure monthly.)</small>													
	Current Month SUVA	Month/Year	Q1			Q2			Q3			Q4		
			04/2009	05/2009	06/2009	07/2009	08/2009	09/2009	10/2009	11/2009	12/2009	01/2010	02/2010	03/2010
	Monthly Raw Water SUVA													
	Quarterly Average													
	RAA													

ACC #6	
--------	--

ACC #7	
--------	--

ACC #8	
--------	--

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____ Certificate No. and Grade: WO0012234, A Date: April 1, 2010

STEP 2 JAR TEST REPORT

FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS


PUBLIC WATER
 SYSTEM NAME: City Of Corsicana
 PWS ID No.: 1750002

PLANT NAME
 OR NUMBER: Lake Halbert WTP
 DATE OF JAR TEST: March 16, 2010

PLANT CONDITIONS								
RAW WATER SOURCE(s)	COAGULANT		COAGULANT AID		FLOC AID		pH ADJUSTMENT	
	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)
Surface	Alum Blend	106.00	NA		NA		Soda Ash	26.00

STEP 2 JAR TEST PARAMETERS									
COAGULANT		BASE		JAR SIZE	JAR TEST CONDITIONS				
Type	Stock Solution Concentration (g/L)	Type	Stock Solution Concentration (g/L)	Volume (liters)	Rapid Mix		Flocculation		Settling
					Speed (rpm)	Duration (minutes)	Speed (rpm)	Duration (minutes)	Duration (minutes)
Dry Alum	11	NA		1000	100.0	1.0	30.0	20.0	40.0

JAR TEST RESULTS										
Jar No.	COAGULANT		BASE		Alkalinity (mg/L as CaCO ₃)	pH	TOC (mg/L)	Incremental TOC Removal (mg/L TOC removed per 10 mg/L of alum)	Cumulative TOC Removal (%)	
	Dose (Alum eq.) (mg/L)	Volume (mL)	Dose (mg/L)	Volume (mL)						
RAW					82	7.7	7.1			
1	10	1.00			Target pH (based on raw water alkalinity)	7.5	7.6	-0.5	bad data point	
2	20	2.00				7.3	6.9	0.7	2.7	
3	30	3.00				7.1	6.9	0.0	2.7	
4	40	4.00				7.0	6.3	0.6	11.1	
5	50	5.00				6.8	5.2	1.1	26.7	
6	60	6.00				6.7	5.2	0.0	26.7	
7	70	7.00				6.6	3.7	1.6	48.5	
8	80	8.00				6.5	3.5	0.2	50.9	
9	90	9.00				6.4	3.4	0.1	52.0	
10	100	10.00				6.3	3.1	0.3	56.3	
11						NA				
12										
Has the TCEQ approved this source as "Not Amenable" to Treatment even though Target pH was not reached? If "yes", provide the date of the TCEQ letter or e-mail.					TOC, % Removal at Apparent PODR:			More than 1 PODR		
					More than one PODR found; please enter correct PODR value:			26.7%		

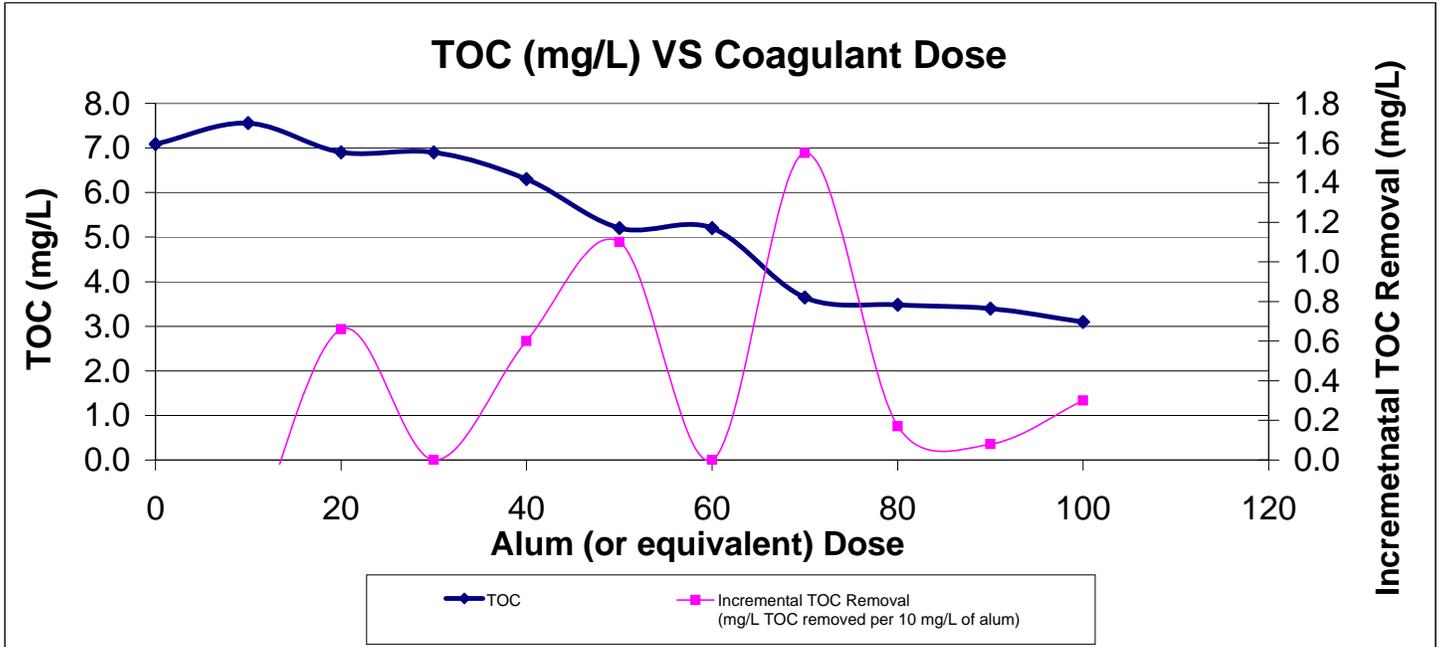

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____

Certificate No. _____
 and Grade: WO0012234, A