

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER

Summary Page

PUBLIC WATER
SYSTEM NAME: City of Corsicana

PLANT NAME
OR NUMBER: Navarro Mills

I certify that I am familiar with the information contained in this report and that,
to the best of my knowledge, the information is true, complete, and accurate.

PWS ID No.: 1750002
Report for
the Month of: June 2014

Operator's Signature: _____
Certificate No. & Grade: WO0004220, A Date: July 1, 2014

TREATMENT PLANT PERFORMANCE

Total number of turbidity readings:	<u>180</u>	Number of 4-hour periods when plant was off-line:	<u>0</u>
Number of readings above 0.10 NTU:	<u>23</u>	Number of 4-hour periods when plant was on-line but turbidity data was not collected:	<u>0</u>
Number of readings above 0.3 NTU:	<u>0</u>	Number of days when plant was on-line but individual filter turbidity data was not collected:	<u>0</u>
Number of readings above 0.5 NTU:	<u>0</u>	Number of days with readings above 1.0 NTU:	<u>0</u> (2)
Number of readings above 1.0 NTU:	<u>0</u>	Number of days with readings above 5.0 NTU:	<u>0</u> (3)
Maximum allowable turbidity level:	<u>0.3</u>		
Percentage of readings above this limit:	<u>0.0</u> % (1)		
Statistical Summary		Maximum turbidity reading:	<u>0.14</u> NTU
		Minimum turbidity reading:	<u>0.05</u> NTU
		CFE 95 th percentile value:	<u>0.12</u> NTU
		Average turbidity value:	<u>0.08</u> NTU
		Standard deviation:	<u>0.020</u> NTU
		IFE 95 th percentile:	<u>0.240</u> NTU
Number of days with a low CT for no more than 4.0 consecutive hours:	<u>0</u>	Average log inactivation for Giardia:	<u>5.78</u>
Number of days with a low CT for more than 4.0 consecutive hours:	<u>0</u> (4)	Average log inactivation for viruses:	<u>61.69</u>
		Number of days when profiling data was not collected:	<u>0</u>
		Number of days when CT data was not collected:	<u>0</u>
Minimum disinfectant residual required leaving the plant:	<u>0.5</u> mg/L, measured as Total Chlorine		
Number of days with a low residual for no more than 4.0 consecutive hours:	<u>0</u>		
Number of days with a low residual for more than 4.0 consecutive hours:	<u>0</u> (5)	Number of days when disinfectant residual leaving the plant was not properly monitored:	<u>0</u>

DISTRIBUTION SYSTEM

Minimum disinfectant residual required in distribution system:	<u>0.5</u> mg/L, measured as Total Chlorine		
Total number of readings this month:	<u>60</u>	(at least 30 required) (8)	
Average disinfectant residual value:	<u>1.82</u>	Percentage of readings with a low residual this month:	<u>0.0</u> % (6A)
Number of readings with a low residual:	<u>0</u>		
Number of readings with no detectable residual:	<u>0</u>	Percentage of readings with a low residual last month:	<u>0.0</u> % (6B)

ADDITIONAL REPORTS & WORKSHEETS

The Page 1 Addendum (Public Notices) is not required because there were no treatment technique or monitoring/reporting violations reported.

Additional report(s) for individual filter monitoring required: NONE Filter Profile Filter Assessment CPE

Additional report(s) for individual filter monitoring submitted: NONE Filter Profile (9) Filter Assessment (10) CPE (11)

No additional IFE Reports are required this month.

SURFACE WATER MONTHLY OPERATING REPORT
TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-155)
P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

SURFACE WATER MONTHLY OPERATING REPORT
 FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
 OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Turbidity Data Page

PUBLIC WATER SYSTEM NAME: City of Corsicana

PLANT NAME OR NUMBER: Navarro Mills

PWS ID No.: 1750002

Connections: 10,855

Month: June Year: 2014

Population: 23,770

PERFORMANCE DATA																		
Date	Raw Water Pumpage (MGD)	Treated Water Pumpage (MGD)	RAW WATER ANALYSES		SETTLED WATER TURBIDITY (Mandatory Data)						FINISHED WATER QUALITY							
			NTU	Alk.	Basin No.						Turbidity						Lowest Residual	Time=
					1	2	3	4	5	6	NTU1	NTU2	NTU3	NTU4	NTU5	NTU6		
1	7.040	6.296	20	125	0.5	0.4	0.5	0.5	0.6	0.5	0.06	0.06	0.05	0.05	0.06	0.06	2.8	
2	7.030	5.970	27	125	0.5	0.4	0.6	0.5	0.6	0.5	0.06	0.06	0.05	0.05	0.05	0.05	2.8	
3	5.390	5.140	21	121	0.4	0.4	0.5	0.5	0.4	0.5	0.06	0.06	0.07	0.07	0.06	0.06	2.7	
4	4.550	4.296	18	119	0.4	0.4	0.4	0.5	0.5	0.5	0.06	0.06	0.07	0.06	0.06	0.06	2.6	
5	4.940	4.994	17	118	0.4	0.4	0.4	0.4	0.4	0.5	0.06	0.06	0.06	0.06	0.07	0.07	2.6	
6	6.930	5.518	16	117	0.4	0.3	0.4	0.4	0.4	0.3	0.05	0.06	0.06	0.06	0.06	0.07	2.8	
7	6.940	6.371	19	117	0.4	0.4	0.4	0.5	0.4	0.4	0.07	0.07	0.07	0.07	0.07	0.07	3.0	
8	5.850	4.839	20	115	0.3	0.4	0.4	0.4	0.4	0.3	0.07	0.07	0.06	0.06	0.07	0.07	2.8	
9	4.550	3.844	20	111	0.4	0.3	0.4	0.3	0.4	0.3	0.07	0.08	0.06	0.08	0.07	0.08	2.6	
10	4.570	4.283	20	108	0.4	0.4	0.4	0.4	0.3	0.4	0.08	0.08	0.08	0.08	0.08	0.08	2.7	
11	5.190	4.894	23	108	0.4	0.4	0.4	0.4	0.4	0.4	0.08	0.08	0.08	0.08	0.09	0.08	2.8	
12	7.020	5.668	23	109	0.4	0.4	0.5	0.4	0.4	0.4	0.08	0.09	0.10	0.09	0.09	0.08	2.9	
13	5.560	4.696	21	114	0.4	0.4	0.5	0.4	0.4	0.4	0.07	0.07	0.07	0.07	0.07	0.07	2.8	
14	4.600	4.906	20	113	0.4	0.4	0.5	0.5	0.4	0.4	0.07	0.07	0.07	0.07	0.07	0.07	2.8	
15	4.510	3.488	20	112	0.3	0.4	0.4	0.4	0.4	0.4	0.07	0.07	0.06	0.06	0.07	0.07	2.8	
16	4.530	5.081	21	108	0.4	0.4	0.5	0.4	0.4	0.4	0.07	0.07	0.07	0.07	0.07	0.07	2.9	
17	7.630	5.606	23	104	0.5	0.5	0.5	0.5	0.4	0.4	0.07	0.07	0.08	0.08	0.10	0.09	2.8	
18	8.120	6.811	20	104	0.5	0.6	0.5	0.5	0.5	0.5	0.10	0.10	0.10	0.11	0.11	0.11	2.9	
19	5.080	5.586	26	104	0.6	0.5	0.5	0.5	0.6	0.5	0.11	0.12	0.12	0.13	0.14	0.13	2.6	
20	4.750	4.684	20	102	0.4	0.4	0.5	0.5	0.5	0.4	0.12	0.11	0.11	0.12	0.12	0.12	2.5	
21	7.000	6.419	17	102	0.4	0.4	0.4	0.6	0.5	0.5	0.12	0.13	0.14	0.13	0.11	0.11	2.8	
22	7.010	5.417	15	104	0.4	0.5	0.6	0.6	0.6	0.5	0.11	0.11	0.10	0.09	0.09	0.09	2.7	
23	5.280	5.260	10	108	0.5	0.4	0.4	0.4	0.4	0.4	0.09	0.08	0.07	0.07	0.06	0.07	2.2	
24	4.370	3.957	12	104	0.4	0.2	0.2	0.3	0.3	0.3	0.06	0.06	0.05	0.05	0.07	0.07	2.2	
25	4.390	4.199	19	108	0.3	0.3	0.3	0.4	0.3	0.4	0.08	0.07	0.07	0.07	0.07	0.07	2.3	
26	4.460	3.664	16	106	0.3	0.3	0.3	0.3	0.3	0.4	0.07	0.07	0.07	0.08	0.08	0.08	2.3	
27	4.490	4.160	19	104	0.4	0.4	0.4	0.5	0.4	0.5	0.07	0.07	0.08	0.07	0.08	0.08	2.5	
28	4.510	4.027	20	107	0.3	0.4	0.4	0.5	0.4	0.4	0.08	0.08	0.08	0.08	0.07	0.07	2.7	
29	4.530	4.388	18	105	0.4	0.4	0.4	0.5	0.4	0.4	0.07	0.07	0.07	0.06	0.06	0.06	2.7	
30	6.280	5.506	17	104	0.5	0.4	0.5	0.4	0.5	0.4	0.06	0.06	0.06	0.06	0.06	0.07	2.7	
31																		
Total	167.100	149.968																
Avg	5.570	4.999																
Max	8.120	6.811																
Min	4.370	3.488																

NOTE: ONLY use the "Time" column to show the length of time that the disinfectant residual entering the distribution system fell below the acceptable level.

SUBMITTED BY: _____ Certificate No. and Grade: WO0004220, A Date: July 1, 2014

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)

Filter Data Page

PUBLIC WATER
SYSTEM NAME: City of Corsicana

PWS ID No.: 1750002

PLANT NAME
OR NUMBER: Navarro Mills

Month: June Year: 2014

PERFORMANCE DATA																				
INDIVIDUAL FILTER TURBIDITY																				
Date	Filter No. 1		Filter No. 2		Filter No. 3		Filter No. 4		Filter No. 5		Filter No. 6		Filter No. 7		Filter No. 8		Filter No. 9		Filter No. 10	
	Max	4 Hrs	Max	4 Hrs																
1	x	x	0.05	x	0.08	x	x	x	0.06	x	0.07	x								
2	x	x	0.57	x	0.08	x	0.11	0.09	0.07	x	0.07	x								
3	x	x	0.21	x	0.08	x	0.09	x	x	x	0.07	x								
4	x	x	x	x	0.08	x	0.09	x	x	x	0.07	x								
5	x	x	x	x	0.07	x	0.08	x	0.24	x	0.07	x								
6	x	x	x	x	0.07	x	0.08	x	0.10	0.10	0.06	x								
7	x	x	x	x	0.08	x	0.08	x	0.10	x	0.07	x								
8	x	x	x	x	0.08	x	0.09	x	0.10	x	0.09	x								
9	x	x	0.17	0.14	0.27	x	0.12	x	0.12	x	x	x								
10	0.24	0.12	0.12	x	x	x	0.09	x	0.10	x	x	x								
11	0.13	x	0.12	x	x	x	x	x	0.09	x	0.15	0.14								
12	0.11	x	0.11	x	x	x	x	x	0.09	x	0.14	x								
13	0.08	x	0.08	x	x	x	x	x	0.27	x	0.09	x								
14	0.08	x	0.08	x	x	x	x	x	x	x	0.09	x								
15	0.08	x	0.12	x	x	x	x	x	x	x	0.11	x								
16	0.10	x	0.09	x	x	x	x	x	x	x	0.11	x								
17	0.15	x	0.13	x	0.24	0.17	x	x	0.34	0.17	0.14	x								
18	0.22	0.09	0.12	x	0.19	x	0.22	0.18	0.19	x	0.13	x								
19	0.21	x	x	x	0.19	x	0.21	x	0.19	x	x	x								
20	0.20	x	x	x	x	x	0.21	x	0.19	x	x	x								
21	0.16	x	x	x	x	x	0.18	x	0.16	x	0.23	x								
22	0.13	x	x	x	x	x	0.14	x	0.13	x	0.16	x								
23	0.07	x	x	x	x	x	0.08	x	0.08	x	0.09	x								
24	0.06	x	x	x	0.12	0.11	0.07	x	x	x	0.08	x								
25	0.07	x	x	x	0.11	x	x	x	0.22	0.14	0.07	x								
26	x	x	x	x	0.10	x	0.15	0.15	0.14	x	0.07	x								
27	x	x	x	x	0.10	x	0.12	x	0.11	x	x	x								
28	x	x	x	x	0.09	x	0.11	x	0.11	x	x	x								
29	x	x	x	x	0.09	x	0.10	x	0.10	x	x	x								
30	0.18	0.11	x	x	0.09	x	0.08	x	0.09	x	0.23	0.12								
31																				

SUMMARY & COMPLIANCE ACTIONS	Criteria	Filter No.										Plant									
		1	2	3	4	5	6	7	8	9	10										
	Number of days with event(s) above 0.5 NTU at 4.0 hrs this month	0	0	0	0	0	0														
	Number of days with event(s) above 1.0 NTU this month	0	0	0	0	0	0														
	Number of days with event(s) above 1.0 NTU last month	0	0	0	0	0	0														
	Number of days with event(s) above 1.0 NTU two months ago	0	0	0	0	0	0														
	Total number of days with event(s) above 1.0 NTU in three months	0	0	0	0	0	0														
	Number of days with event(s) above 2.0 NTU this month											0									
	Number of days with event(s) above 2.0 NTU last month											0									
	Does the filter/plant have an approved Corrective Action Plan?	N	N	N	N	N	N														N
	Is the plant required to submit a Filter Profile Report?	N	N	N	N	N	N														
	Is the plant required to submit a Filter Assessment Report?	N	N	N	N	N	N														
	Is the plant required to submit a Request for Compliance CPE?											N									

SUBMITTED BY: _____ Certificate No. WO0004220, A and Grade: _____ Date: July 1, 2014

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Disinfection Data Page

PUBLIC WATER SYSTEM NAME: City of Corsicana
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills
Month: June Year: 2014

DISINFECTION PROCESS PARAMETERS									
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS				
Parameters	Disinfection Zones					Log Inactivations			
	D1	D2	D3	D4	D5	Giardia lamblia Cysts		Viruses	
Flow Rate (MGD)	20.250	20.250	20.250			0.5		2.0	
T ₁₀ (minutes)	109.1	13.0	100.0						

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time=
1	NA D1								
	FCL D2	0.6	7.100	26.0	7.1				
	CLA D3	2.8	7.100	26.0	7.6	5.07	57.86	10.13	
	D4							(G)	
	D5								
2	NA D1								
	FCL D2	0.5	7.100	26.0	7.1				
	CLA D3	3.0	7.100	26.0	7.6	4.99	50.12	9.97	
	D4							(G)	
	D5								
3	NA D1								
	FCL D2	0.7	7.100	26.0	7.1				
	CLA D3	2.8	7.100	26.0	7.7	5.36	66.17	10.73	
	D4							(G)	
	D5								
4	NA D1								
	FCL D2	0.4	4.600	27.0	7.1				
	CLA D3	2.6	4.600	27.0	7.7	6.67	67.27	13.34	
	D4							(G)	
	D5								
5	NA D1								
	FCL D2	0.6	6.900	27.0	7.2				
	CLA D3	2.8	6.900	27.0	7.8	5.28	63.81	10.56	
	D4							(G)	
	D5								
6	NA D1								
	FCL D2	0.7	7.000	27.0	7.2				
	CLA D3	2.8	7.000	28.0	7.8	5.52	72.55	11.03	
	D4							(G)	
	D5								
7	NA D1								
	FCL D2	0.5	7.000	28.0	7.1				
	CLA D3	3.0	7.000	28.0	7.7	5.30	58.39	10.61	
	D4							(G)	
	D5								
8	NA D1								
	FCL D2	0.5	7.000	28.0	7.2				
	CLA D3	2.9	7.000	28.0	7.7	5.12	58.06	10.25	
	D4							(G)	
	D5								

PERFORMANCE DATA									
DISINFECTION PROCESS DATA									
Date	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time=
9	NA D1								
	FCL D2	0.5	4.600	28.0	7.2				
	CLA D3	2.7	4.600	28.0	7.7	7.45	87.34	14.90	
	D4							(G)	
	D5								
10	NA D1								
	FCL D2	0.5	4.600	28.0	7.3				
	CLA D3	2.7	4.600	28.0	7.7	7.35	87.34	14.71	
	D4							(G)	
	D5								
11	NA D1								
	FCL D2	0.4	7.100	28.0	7.2				
	CLA D3	3.0	7.100	28.0	7.7	4.82	48.02	9.64	
	D4							(G)	
	D5								
12	NA D1								
	FCL D2	0.4	7.100	27.0	7.2				
	CLA D3	3.1	7.100	28.0	7.6	4.83	45.79	9.67	
	D4							(G)	
	D5								
13	NA D1								
	FCL D2	0.7	7.100	28.0	7.1				
	CLA D3	3.0	7.100	28.0	7.6	5.92	76.66	11.84	
	D4							(G)	
	D5								
14	NA D1								
	FCL D2	0.4	4.700	28.0	7.1				
	CLA D3	2.9	4.700	28.0	7.6	7.19	72.05	14.38	
	D4							(G)	
	D5								
15	NA D1								
	FCL D2	0.5	4.600	28.0	7.2				
	CLA D3	2.8	4.600	28.0	7.6	7.62	87.85	15.25	
	D4							(G)	
	D5								
16	NA D1								
	FCL D2	0.4	4.600	29.0	7.1				
	CLA D3	3.0	4.600	28.0	7.8	7.69	78.35	15.37	
	D4							(G)	
	D5								

NOTE: = ONLY use the "Time=" column to show the length of time that the total inactivation ratio was less than 1.00.

SUBMITTED BY: _____ Certificate No. and Grade: WO0004220, A Date: July 1, 2014

SURFACE WATER MONTHLY OPERATING REPORT

FOR PUBLIC WATER SYSTEMS THAT ARE USING SURFACE WATER SOURCES
OR GROUND WATER SOURCES UNDER THE INFLUENCE OF SURFACE WATER (cont.)
Disinfection Data Page (cont.)

PUBLIC WATER SYSTEM NAME: City of Corsicana
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills
Month: June Year: 2014

DISINFECTION PROCESS PARAMETERS							
APPROVED CT STUDY PARAMETERS					PERFORMANCE STANDARDS		
Parameters	Disinfection Zones					Log Inactivations	
	D1	D2	D3	D4	D5	Giardia lamblia Cysts	Virus
Flow Rate (MGD)	20.250	20.250	20.250				
T ₁₀ (minutes)	109.1	13.0	100.0			0.5	2.0

PERFORMANCE DATA									
Date	DISINFECTION PROCESS DATA								
	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time=
17	NA D1								
	FCL D2	0.4	9.300	28.0	7.1				
	CLA D3	2.8	9.300	28.0	7.7	3.55	36.16	7.10	
	D4							(G)	
	D5								
18	NA D1								
	FCL D2	0.6	9.300	28.0	7.1				
	CLA D3	3.0	9.300	29.0	7.6	4.26	51.78	8.52	
	D4							(G)	
	D5								
19	NA D1								
	FCL D2	0.5	7.100	29.0	7.1				
	CLA D3	2.8	7.100	29.0	7.6	5.14	61.00	10.28	
	D4							(G)	
	D5								
20	NA D1								
	FCL D2	0.4	4.600	29.0	7.1				
	CLA D3	2.6	4.600	29.0	7.5	7.00	77.27	13.99	
	D4							(G)	
	D5								
21	NA D1								
	FCL D2	0.4	7.100	29.0	7.1				
	CLA D3	2.8	7.100	29.0	7.5	4.76	50.77	9.51	
	D4							(G)	
	D5								
22	NA D1								
	FCL D2	0.4	7.000	29.0	7.0				
	CLA D3	2.7	7.000	29.0	7.5	4.77	51.14	9.54	
	D4							(G)	
	D5								
23	NA D1								
	FCL D2	0.2	7.200	28.0	6.9				
	CLA D3	2.6	7.200	29.0	7.4	3.67	27.84	7.34	
	D4							(G)	
	D5								
24	NA D1								
	FCL D2	0.2	4.500	29.0	7.1				
	CLA D3	2.3	4.500	29.0	7.5	5.34	45.04	10.68	
	D4							(G)	
	D5								

PERFORMANCE DATA										
Date	DISINFECTION PROCESS DATA									
	Disinfectant	C (mg/L)	Flow (MGD)	Temp (°C)	pH	Giardia Log	Virus Log	Inact. Ratio	Time=	
25	NA D1									
	FCL D2	0.2	4.400	29.0	6.9					
	CLA D3	2.5	4.400	29.0	7.7	5.92	47.20	11.84		
	D4							(G)		
	D5									
26	NA D1									
	FCL D2	0.3	4.500	29.0	6.9					
	CLA D3	2.5	4.500	29.0	7.7	6.47	62.29	12.95		
	D4							(G)		
	D5									
27	NA D1									
	FCL D2	0.4	4.600	29.0	7.1					
	CLA D3	2.6	4.600	29.0	7.7	7.00	77.27	13.99		
	D4							(G)		
	D5									
28	NA D1									
	FCL D2	0.4	4.500	28.0	7.0					
	CLA D3	2.9	4.500	29.0	7.7	7.59	76.33	15.19		
	D4							(G)		
	D5									
29	NA D1									
	FCL D2	0.2	4.600	29.0	7.1					
	CLA D3	3.0	4.600	29.0	7.9	6.43	47.85	12.87		
	D4							(G)		
	D5									
30	NA D1									
	FCL D2	0.5	7.200	29.0	7.1					
	CLA D3	3.1	7.200	29.0	8.0	5.40	61.19	10.80		
	D4							(G)		
	D5									
31	D1									
	D2									
	D3									
	D4									
	D5									
								Max	7.69	87.85
								Min	3.55	27.84
								Avg	5.78	61.69
								SD	1.17	15.17

NOTE: = ONLY use the "Time=" column to show the length of time that the total inactivation ratio was less than 1.00.

SUBMITTED BY: _____ Certificate No. and Grade: WO0004220, A Date: July 1, 2014

MONTHLY TOTAL ORGANIC CARBON REMOVAL REPORT (TOCMOR)

FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana
 PWS ID No.: 1750002
 Type of treatment: Conventional Unconventional explain: _____

PLANT NAME OR NUMBER: Navarro Mills
 Month: June Year: 2014

Note: Systems are required to run one TOC Sample Set every month. Additional space is provided for those systems that do additional sampling

Test No.	Test Date	Monthly TOC Sample Set			Actual % TOC Removed	Step 1 Required Removal %	Step 1 Removal Ratio	Optional data		COMPLIANCE REMOVAL RATIO
		Raw Alkalinity	Raw TOC	Treated TOC				Step 2 Required % Removal	Step 2 Removal Ratio	
		Enter the Sample Set results						calculated	calculated from matrix	
1	6/3	129	4.89	3.94	19.4	25	0.78			0.78
2										
3										
4										
5										
6										
7										
8										
9										
10										
11										
12										
13										
14										
15										
16										
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
31										
Avg		129.00	4.89	3.94	19.43		0.78			0.78
Max		129.00	4.89	3.94	19.43		0.78			0.78
Min		129.00	4.89	3.94	19.43		0.78			0.78

TOTAL ORGANIC CARBON (TOC) REMOVAL SUMMARY

TOC Summary: Don't forget to include a copy of your P.7-TOC ACC worksheet with your report.					Monthly Compliance Ratio
Raw Water Alkalinity	Raw Water TOC	Treated Water TOC	TOC % Removal	ACC # used	
129	4.89	3.94	19.4	5 RAA	1.00

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____

Certificate No. and Grade: WO0004220, A

Date: July 1, 2014

Submit the report by the 10th of the month following the reporting period to:
 TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
 WATER SUPPLY DIVISION/PUBLIC DRINKING WATER SECTION (MC-155)
 P.O. BOX 13087, AUSTIN, TEXAS 78711-3087

TOC ALTERNATIVE COMPLIANCE CRITERIA REPORT
FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana
PWS ID No.: 1750002

PLANT NAME OR NUMBER: Navarro Mills
Month: June Year: 2014

This Alternative Compliance Criteria (ACC) Report is being submitted to request the following ACC: (check one)
(Before you can begin entering data, you must put an "X" in the box that shows the number of the Alternative Compliance Criteria you are applying for.)

#1 #2 #3 #4 #5 #6 #7 #8

ACC #1

ACC #2

ACC #3

ACC #4

ACC #	Current Month SUVA	Source water SUVA less than or equal to 2.0 L/mg-m? (either based on most recent month's data OR calculated quarterly as a running annual average) (Source water SUVA is the dissolved organic carbon concentration divided by the ultraviolet light absorption at 254 nanometers in the source water before any treatment of any kind. Measure monthly.)											
		Q1			Q2			Q3			Q4		
		07/2013	08/2013	09/2013	10/2013	11/2013	12/2013	01/2014	02/2014	03/2014	04/2014	05/2014	06/2014
5		1.68	1.65	1.67	1.69	1.81	2.32	2.09	2.24	2.09	1.92	1.76	2.02
	Monthly Raw Water SUVA			1.67			1.94			2.14			1.90
	Quarterly Average RAA												1.91

ACC #6

ACC #7

ACC #8

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____ Certificate No. and Grade: WO0004220, A Date: July 1, 2014

STEP 2 JAR TEST REPORT

FOR SURFACE WATER OR GROUND WATER UNDER THE INFLUENCE OF SURFACE WATER SYSTEMS

PUBLIC WATER SYSTEM NAME: City of Corsicana
 PWS ID No.: 1750002


PLANT NAME OR NUMBER: Navarro Mills
 DATE OF JAR TEST: _____

PLANT CONDITIONS								
RAW WATER SOURCE(s)	COAGULANT		COAGULANT AID		FLOC AID		pH ADJUSTMENT	
	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)	Type	Dose (mg/L)

STEP 2 JAR TEST PARAMETERS									
COAGULANT		BASE		JAR SIZE	JAR TEST CONDITIONS				
Type	Stock Solution Concentration (g/L)	Type	Stock Solution Concentration (g/L)	Volume (liters)	Rapid Mix		Flocculation		Settling
					Speed (rpm)	Duration (minutes)	Speed (rpm)	Duration (minutes)	Duration (minutes)

JAR TEST RESULTS									
Jar No.	COAGULANT		BASE		Alkalinity (mg/L as CaCO ₃)	pH	TOC (mg/L)	Incremental TOC Removal (mg/L TOC removed per 10 mg/L of alum)	Cumulative TOC Removal (%)
	Dose (Alum eq.) (mg/L)	Volume (mL)	Dose (mg/L)	Volume (mL)					
RAW									
1									
2									
3									
4									
5					Target pH (based on raw water alkalinity)				
6									
7									
8									
9									
10									
11									
12									

Has the TCEQ approved this source as "Not Amenable" to Treatment even though Target pH was not reached? If "yes", provide the date of the TCEQ letter or e-mail.	TOC, % Removal at Apparent PODR:
---	----------------------------------

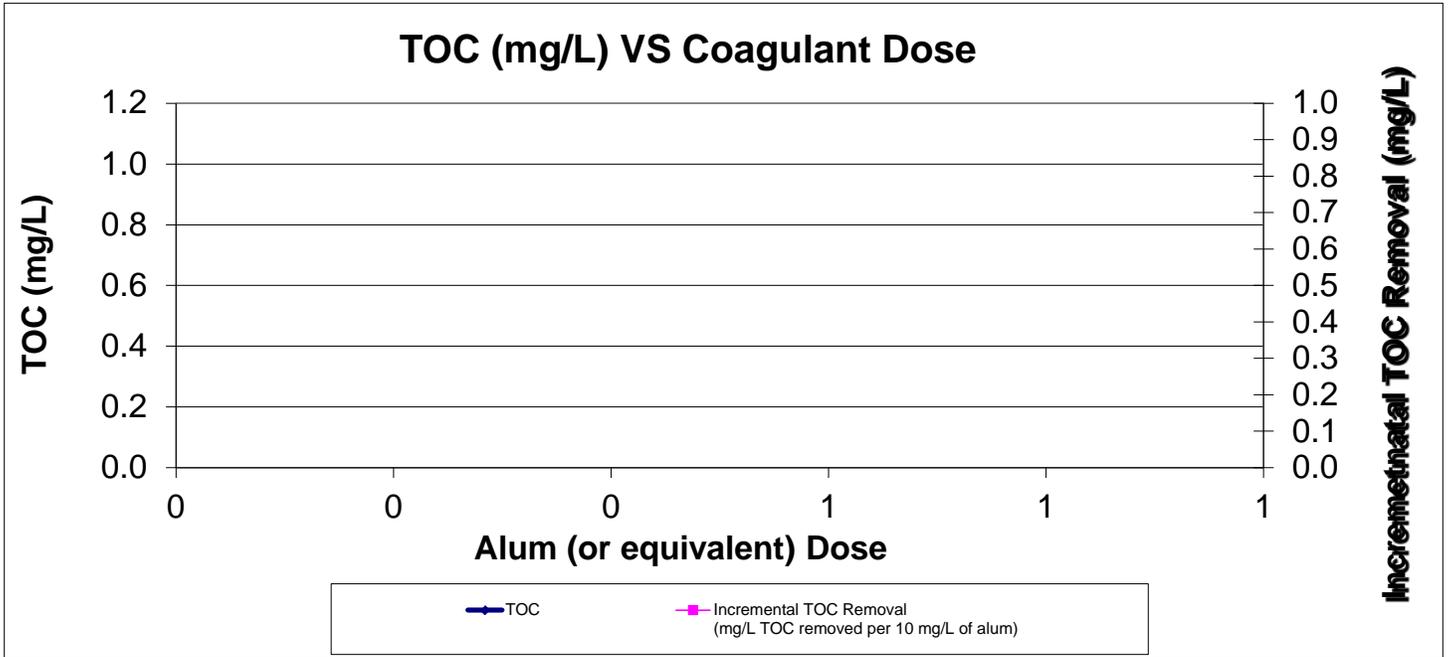

I certify that I am familiar with the information contained in this report and that, to the best of my knowledge, the information is true, complete, and accurate.

Operator's Signature: _____

Certificate No. and Grade: WO0004220, A